


- NOTES:
1. DIMENSIONS MAY VARY BY ± 1/2 INCH [13mm].
 2. TO COMPLY WITH ANSI Z368.1-2009 FOR EMERGENCY EYEWASH OR EYEFACE WASH AND SHOWER EQUIPMENT:
 - UNIT SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS AND ACCEPTABLE PLUMBING PRACTICES.
 - EYEWASH OR EYEFACE WASH SHALL BE POSITIONED WITH NOZZLES NOT LESS THEN 83.8 CM (33 IN.) AND NO GREATER THAN 114.3 CM (45 IN.) FROM SURFACE ON WHICH USER STANDS AND 15.3 CM (6 IN.) MINIMUM FROM WALL OR NEAREST OBSTRUCTION.
 - SHOWER SHALL BE POSITIONED SO THAT SHOWER HEAD IS NOT LESS THAN 208.3 CM (82 IN.) NOR MORE THAN 243.8 CM (96 IN.) FROM SURFACE ON WHICH USER STANDS.
 - SHOWER SPRAY PATTERN SHALL HAVE A MINIMUM DIAMETER OF 50.8 CM (20 IN.) AT 152.4 CM (60 IN.) ABOVE SURFACE ON WHICH USER STANDS, AND CENTER OF SPRAY PATTERN SHALL BE LOCATED AT LEAST 40.6 CM (16 IN.) FROM ANY OBSTRUCTION.
 3. DO NOT USE REGULAR PIPE SEALANT. IF NECESSARY USE DOW CORNING 832 SEALANT PLACING 5 SMALL BEADS ON THE MALE THREADS, JUST ABOVE THE FIRST THREAD.


(NOTES CONTINUED ON SHEET 2 OF 4.)

1-1/4" IPS SUPPLY UNION (INLET)
TOP SUPPLY SHOWN. SEE STEP 2
OF THE INSTALLATION PROCEDURE
IN THE OPERATION & MAINTENANCE
MANUAL (PAGE 2) TO CONVERT
TO A BOTTOM SUPPLY UNIT.

IMPORTANT
SUPPLY MUST BE HEAT
TRACED AND INSULATED

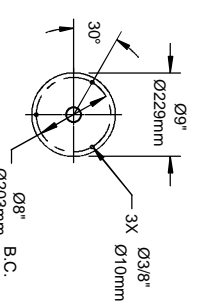

MOUNTING DETAIL B



DETAIL A
NOTE: PULL ROD AND HANDLE NOT
ASSEMBLED. ORIENTATION OF HANDLE
MUST BE IN UP POSITION WHEN FULLY
CLOSED AND PULL ROD INSERTED IN
HOLE SHOWN.

SP1588 FREEZE PROTECTION VALVE
(SEE NOTES ON SHEETS 2 & 3 FOR
INSTALLATION INSTRUCTIONS.)



Haws

1455 KLEPPE LANE
SPARKS, NEVADA, 89431
(775) 359-4712 FAX (775) 389-7424
E-MAIL: HAWS@HAWS.CO.COM
WEBSITE: WWW.HAWS.CO.COM


EGNNO	REVISED PER BY:	MODEL(S)
DRAWN:	ECN: 4921	8317CTFP(120V) 8317CTFP.220V
RTN	DATE	
APPROVED	DATE	
SCALE:	1/20	DRAWING TYPE:
INSTALLATION		
SHEET	1	OF
PART NUMBER	0002081781.D	
DRAWING NO.	15201A00	REV
	17	

NOTES: (CONTINUED FROM SHEET 1 OF 4)

4. FREEZE PROTECTION VALVE INSTALLATION INSTRUCTIONS:

- A** INSTALL VALVE SUB-ASSEMBLY INTO FEMALE SECTION OF UNION AND TIGHTEN WATER-TIGHT.
- B** FORM HEAT TRACE CABLE AROUND VALVE AND PLUG. APPLY 2X CABLE-TIES TO HEAT TRACE CABLE, AS SHOWN, ENSURING THAT HEAT TRACE CABLE IS PRESSED FIRMLY AGAINST SIDES OF VALVE (PUSH ANY LOOSE HEAT TRACE CABLE BACK INSIDE JACKET THROUGH RUBBER GROMMET). TRIM EXCESS CABLE-TIE STRAPPING.
- C** SLIDE INNER TUBE W/ PLUGGED END OVER VALVE WITH ADHESIVE SEAM FACING BOTTOM AND NON-PLUGGED END OF TUBE BUTTED UP AGAINST UNION SURFACE. REMOVE 2X ADHESIVE TAPE FROM SEAM AND SQUEEZE ADHESIVE SEAMS TOGETHER AROUND VALVE. APPLY 2X CABLE-TIES TO TUBE, IN APPROXIMATE LOCATIONS SHOWN. TRIM EXCESS CABLE-TIE STRAPPING.

(NOTES CONTINUED ON SHEET 3 OF 4)

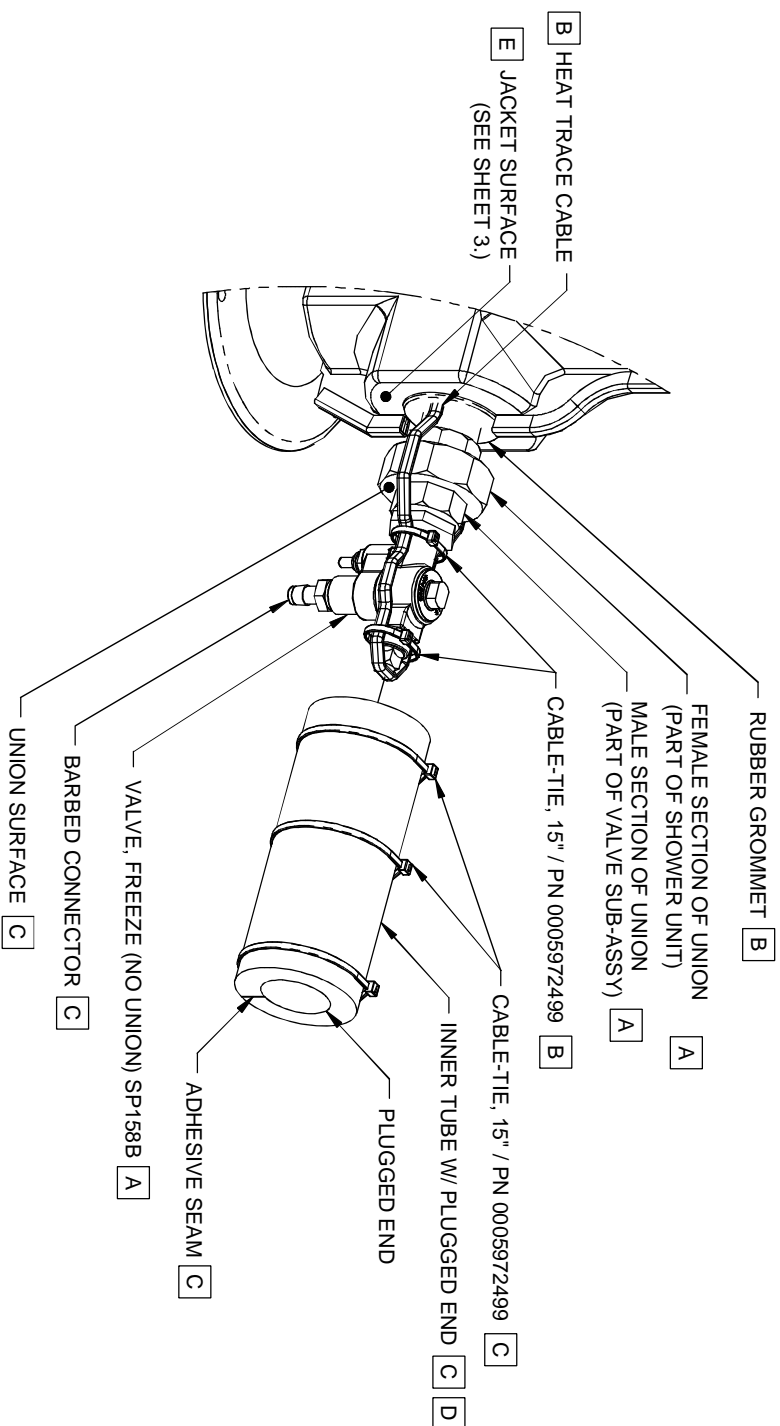

SP158B VALVE SHOWN CONNECTED TO BOTTOM UNION FOR REFERENCE ONLY. VALVE CAN BE INSTALLED AT TOP OR BOTTOM.

1455 KLEPPLE LANE
SPARKS, NEVADA 89431
(775) 359-4712 FAX (755) 359-7424
E-MAIL: HAWS@HAWSCO.COM
WEBSITE: WWW.HAWSCO.COM


ECON NO:	REVISED PERBY:	MODEL(S)	PART NUMBER
4632	ECN: 4921	HM	0002081781.D
DRAWN:	DATE:	CHKD:	DRAWING NO. REV
VWC	12/2/12		15201A 17
APPROVED:	DATE:	SCALE:	INSTALLATION
FV	10/21/14	NA	SIZE: A SHEET: 2 OF 4

NOTES: (CONTINUED FROM SHEET 2 OF 4)


5. FREEZE PROTECTION VALVE INSTALLATION INSTRUCTIONS (CONTINUED):


D WRAP OUTER TUBE OVER INNER TUBE ENCAPSULATED VALVE WITH ADHESIVE SEAM ORIENTED PERPENDICULAR TO SEAM OF INNER TUBE. PUSH OUTER TUBE UP AGAINST JACKET SURFACE. WHEN TUBE IS MOUNTED FIRMLY AGAINST JACKET SURFACE, SQUEEZE TUBE AT BARBED CONNECTOR SUCH THAT BARBED NIPPLE PUSHES THROUGH OUTER TUBE WALL. (PUSHING CONNECTOR THROUGH WALL WILL EXTRUDE A CYLINDRICAL PLUG OF TUBING TO BREAK FREE. DISCARD PLUG.) PUSH TUBE DOWN EVEN FURTHER SO THAT HOLE IN TUBE STRETCHES AROUND HEXAGONAL BOSS OF CONNECTOR. SQUEEZE OUTER TUBE TIGHT UNTIL ADHESIVE SEAMS ARE CLOSE ENOUGH TO SEAL. REMOVE PROTECTIVE TAPE AND SEAL SEAMS.

E TO ENSURE PROPER INSULATION OF UNION: THERE MUST BE NO SPACE BETWEEN OUTER TUBE AND JACKET SURFACE (SEE SHEET 2 FOR SURFACE CALLOUT). THEREFORE, SLICE TWO PLACES. TOP SIDE AND BOTTOM SIDE. COMPLETELY THROUGH OUTER TUBE TO A LENGTH EQUAL TO DEPTH OF TRIM SEAL. FORCE SLICED TUBE AROUND TRIM SEAL AND PUSH TUBE TIGHTLY AGAINST JACKET, AS SHOWN. APPLY 2X CABLE-TIE HEAD, AND 2X CABLE-TIE STRAP, TO TUBE, IN APPROXIMATE LOCATIONS SHOWN. TRIM EXCESS STRAPPING.

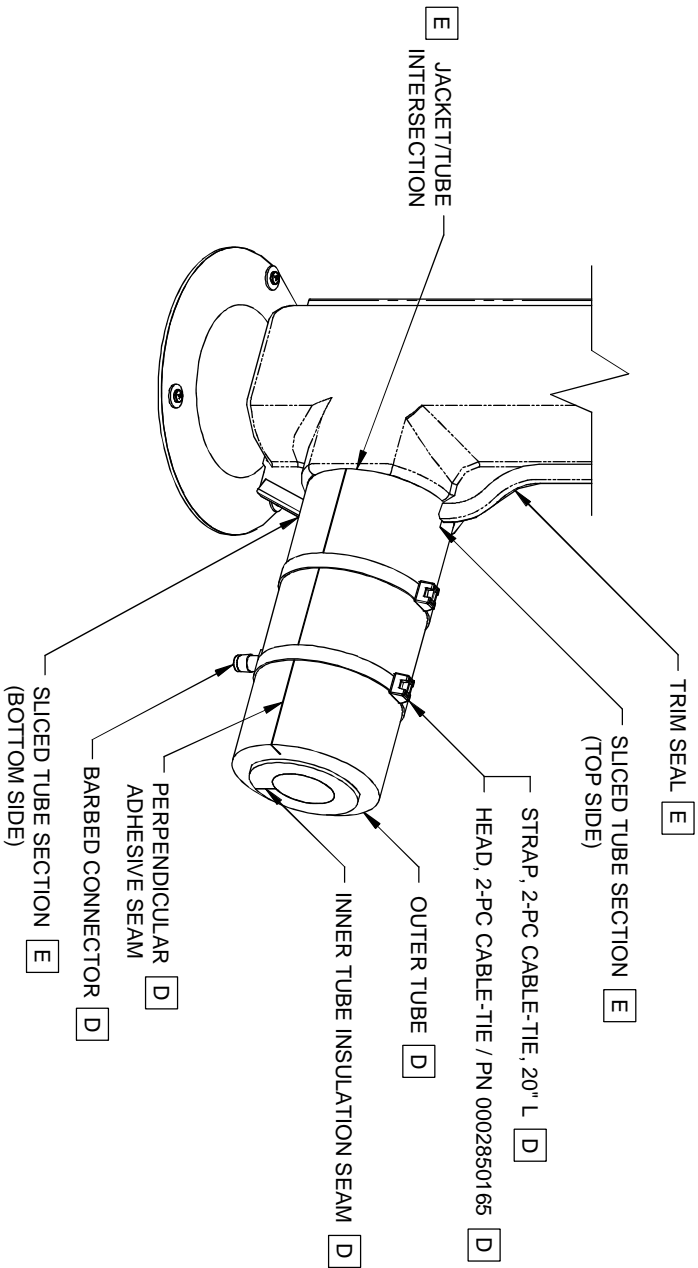

SP158B VALVE SHOWN CONNECTED TO BOTTOM UNION FOR REFERENCE ONLY. VALVE CAN BE INSTALLED AT TOP OR BOTTOM.

				1455 KLEPPPE LANE SPARKS, NEVADA 89431 (775) 389-4712 FAX (735) 389-7424 E-MAIL: HAWS@HAWSCO.COM WEBSITE: WWW.HAWSCO.COM	
ECN NO. 4632 DR. AVN. VAVC APPROVED BY PJ	REVISOR PERBY ECN. 4921 DATE: 1/29/12	MODEL(S) 8317CTFP(120V) / 8317CTFP.220V	SCALE: NA	DRAWING TYPE: INSTALLATION	PART NUMBER: 0002081781.D DRAWING NO.: 152014 REV: 17

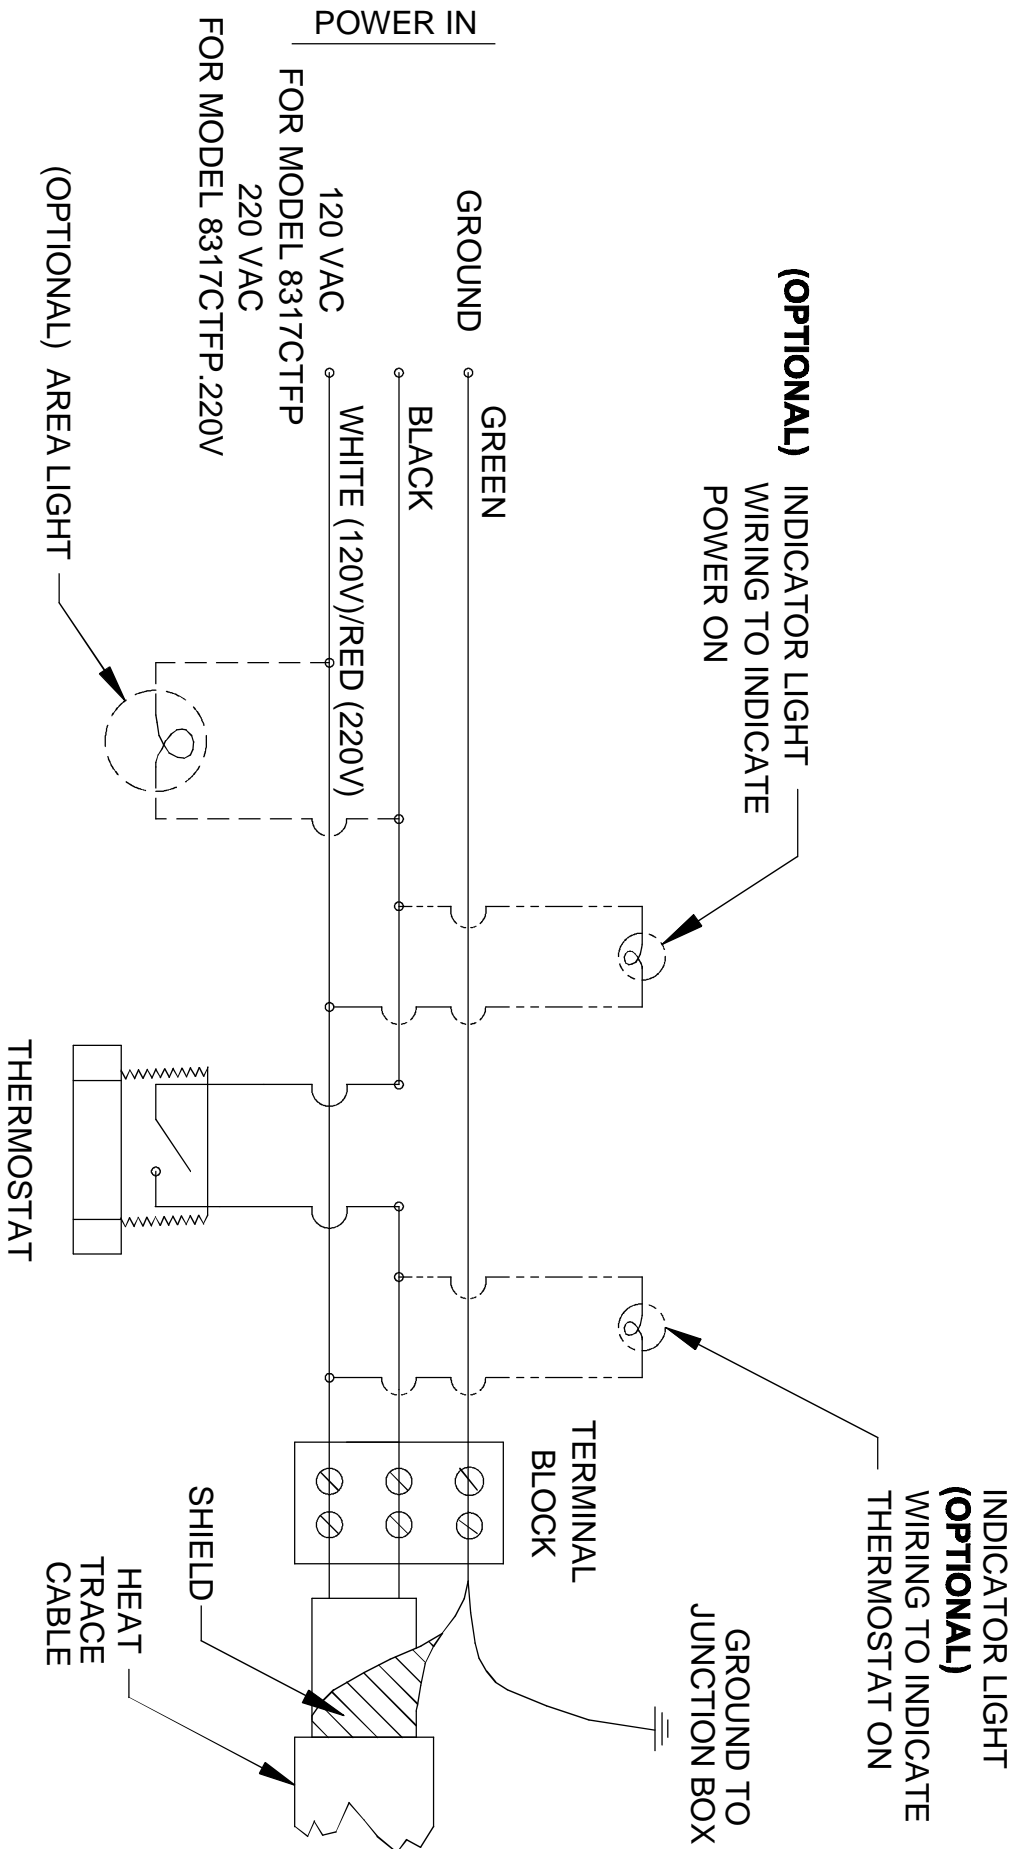

ELECTRICAL SCHEMATIC

(8317CTFP ONLY SUPPORTS TWO OPTIONS AT A TIME)

		1485 KLEPPE LANE SPARKS, NEVADA 89431 (775) 359-4712 FAX (759) 359-7424 E-MAIL: HAWS@HAWSCO.COM WEBSITE: WWW.HAWSCO.COM	
ECN NO. REVISED PER BY:	MODEL(S)	8317CTFP(120V)/ 8317CTFP.220V	
DRAWN: KIM	DATE: 02/29/05	SCALE: NA	DRAWING TYPE: INSTALLATION
APPROVED: FV	DATE: 02/11/14	SIZE: A	SHEET: 4 OF 4
PART NUMBER		0002081781.D	
DRAWING NO.		15201A00	
REV		17	